



Renewable Energy for Water Desalination

Course Number: CH-02-104

PDH: 2

Approved for: AK, AL, AR, GA, IA, IL, IN, KS, KY, LA, MD, ME, MI, MN, MO, MS, MT, NC, ND, NE, NH, NJ, NM, NV, OH, OK, OR, PA, SC, SD, TN, TX, UT, VA, VT, WI, WV, and WY

New Jersey Professional Competency Approval #24GP00025600

North Carolina Approved Sponsor #S-0695

Maryland Approved Provider of Continuing Professional Competency

Indiana Continuing Education Provider #CE21800088

This document is the course text. You may review this material at your leisure before or after you purchase the course. In order to obtain credit for this course, complete the following steps:

- 1) Log in to My Account and purchase the course. If you don't have an account, go to New User to create an account.
- 2) After the course has been purchased, review the technical material and then complete the quiz at your convenience.
- 3) A Certificate of Completion is available once you pass the exam (70% or greater). If a passing grade is not obtained, you may take the quiz as many times as necessary until a passing grade is obtained (up to one year from the purchase date).

If you have any questions or technical difficulties, please call (508) 298-4787 or email us at admin@PDH-Pro.com.





ETSAP
ENERGY TECHNOLOGY SYSTEMS ANALYSIS PROGRAMME



Water Desalination Using Renewable Energy

Technology Brief

IEA-ETSAP and IRENA® Technology Brief I12 – March 2012

www.etsap.org – www.irena.org

Insights for Policymakers

Global demand for water continues to increase whilst freshwater sources are becoming more scarce due to increasing demand for natural resources and the impacts of climate change, particularly in semi-arid and coastal/island areas. Desalination of seawater and brackish water can be used to augment the increasing demand for fresh water supplies. However, desalination is a very energy intensive process, often using energy supply from fossil fuel sources which are vulnerable to volatile global market prices as well as logistical supply problems in remote and island communities and are therefore not sustainable.

Until now, the majority of desalination plants have been located in regions with high availability and low costs of energy. Current information on desalination shows that only 1% of total desalinated water is based on energy from renewable sources. Renewables are becoming increasingly mainstream and technology prices continue to decline, thus making renewable energy a viable option. With increasing demand for desalinated water in energy-importing countries such as India, China and small islands, there is a large market potential for renewable energy-powered desalination systems worldwide.

There are two broad categories of desalination technologies. Thermal desalination uses heat to vaporise fresh water, while membrane desalination (reverse osmosis) uses high pressure from electrically-powered pumps to separate fresh water from seawater or brackish water using a membrane. Policy makers need to consider these different technology choices for desalination and base their decisions on locally available renewable energy sources. For example, solar energy – in particular heat from concentrated solar power (CSP) for thermal desalination and electricity from solar photovoltaic and CSP for membrane desalination – is a key solution in arid regions (e.g. the MENA region) with extensive solar energy potentials, whilst wind energy is of interest for membrane desalination projects in coastal and island communities.

While desalination is still costly, declining renewable energy technology deployment costs are expected to bring this cost down in the coming years. This is of particular interest to remote regions and islands with small populations and poor infrastructure for freshwater and electricity transmission and distribution.

Mapping water needs and renewable energy sources is a strategic tool for planning new desalination systems. Renewable energy-powered desalination could be a key enabler for continued growth, especially in those countries that rely on desalinated water for sustaining local communities and productive uses such as irrigation. As such, renewable energy generation should be seen as a valuable economic investment that reduces external, social, environmental and operational costs. Policy makers may therefore wish to take the evolving market opportunities and long term impacts of technology options into consideration when planning their capacity, infrastructure and sustainable water supply needs.

Highlights

- **Process and Technology Status** – This brief focuses primarily on water desalination based on the use of renewable energy, i.e. *renewable desalination*. Global water withdrawals amount to around 4,000 billion m³ per year and in some regions – especially the Middle East and Northern Africa (MENA) – desalination has become the most important source of water for drinking and agriculture. Today's global desalinated water production amounts to about 65.2 million m³ per day (24 billion m³ per year), equivalent to 0.6% of global water supply. The MENA region accounts for about 38% of the global desalination capacity, with Saudi Arabia being the largest desalinating country. Major desalination technology options are based on thermal processes using both heat and electricity, and membrane technologies using electricity only. The dominant technology is Reverse Osmosis (RO), which accounts for 60% of the global capacity, followed by Multi Stage Flash (MSF), with a 26.8% share. The larger desalination plants can reach a capacity of up to 800,000 m³ per day or more. Renewable energy can play an important role in desalination. Renewable technologies that are suited to desalination include solar thermal, solar photovoltaics (PV), wind, and geothermal energy. Solar technologies based on solar heat concentration, notably concentrating solar power (CSP), produce a large amount of heat that is suited to thermal desalination. Photovoltaic and wind electricity is often combined with membrane desalination units (reverse osmosis, electrodialysis). As electricity storage is still a challenge, combining power generation and water desalination can also be a cost-effective option for electricity storage when generation exceeds demand.
- **Performance and Costs** – Desalination requires a considerable amount of energy. Seawater desalination via MSF consumes typically 80.6 kWh of heat energy (290 MJ thermal energy per kg) plus 2.5 to 3.5 kWh of electricity per m³ of water, while large scale RO requires only about 3.5 to 5.0 kWh of electricity per m³. Currently, the global production of about 65.2 million m³/d of desalinated water involves the use of at least 75.2 TWh per year, which equals about 0.4% of the global electricity consumption. The cost of desalination has been decreasing over the last years down to USD 0.5/m³, while market prices for desalinated water are typically between USD 1/m³ and USD 2/m³. Therefore, desalination is currently affordable for middle-income regions, not yet for the poorest countries. The economics of *renewable desalination* depends on the cost of renewable energy as the cost of desalination is largely determined by the energy costs. In general, the cost of *renewable desalination* is still higher if compared to the cost of conventional desalination based on fossil fuels as the energy input. However, the costs of renewable technologies are quickly decreasing and *renewable desalination* can already compete with

conventional systems in remote regions where the cost of energy transmission and distribution is higher than the cost of distributed generation.

- **Potential and Barriers –** Desalination demand is projected to expand rapidly. The global demand is projected to grow by 9% per year between 2010 and 2016, with a cumulative investment of about USD 88 billion. In the MENA region, water demand is expected to increase from 9 billion m³ in 2010 up to 13.3 billion m³ in 2030 while groundwater resources are projected to decrease. As a consequence, desalination capacity in the MENA region is expected to grow quickly from 21 million m³/d in 2007 to nearly 110 million m³/d by 2030, of which 70% is in Saudi Arabia, the United Arab Emirates, Kuwait, Algeria and Libya. As desalination requires a considerable amount of energy, water production in MENA countries will contribute significantly to increase the energy use. The total electricity demand for desalination in the MENA region is expected to rise to some 122 TWh by 2030, thus tripling compared with the 2007 level. Desalination demand is also expected to grow in Asia and the Caribbean region. China and India are high potential markets for desalination due to growing population and economies, and water shortage. The need for desalination grows much faster than the economy as a whole, and the associated energy need is projected to increase accordingly.

Technologies and Performance

The global water demand is continuously increasing due to population growth and economic development. Global water withdrawals exceed 4,000 billion m³ per year (Rosegrant et al, 2002) and about 25% of the world population encounters fresh water scarcity (UN OCHA, 2010). In response to the increasing demand, desalination has become the most important source of water for drinking and agriculture in some world regions, especially the Middle East and North Africa (MENA), and some of the Caribbean islands, where water is particularly scarce. The International Desalination Association (IDA) reports that there are about 15,000 desalination plants worldwide, with a global capacity of 71.7 million m³/d. About 60% of feed water used in these plants is seawater (IDA in Black and Veatch, 2011). Over the past years, the deployment of desalination plants has been led by countries of the MENA region where approximately 2,800 desalination plants produce 27 million m³/d fresh water (about 38% of the global capacity) from seawater (Fichtner, 2011). Major desalination technologies consist of thermal processes using either thermal power or electricity as the energy input, or membrane-based processes using only electricity (Table 1). The dominant desalination processes in use today are based on Reverse Osmosis (RO) and Multi Stage Flash (MSF) which constitute 60.0% and 26.8% of the worldwide capacity, respectively (Figure 1). The feasibility of each technology depends on specific conditions such as energy price, water quality and the technical resources of the region.

- **Thermal Desalination Technologies** – Thermal desalination involves distillation processes where saline feed-water is heated to vaporize, causing fresh water to evaporate and leave behind a highly saline solution, namely the brine. Freshwater is then obtained from vapor cooling and condensation. The **Multi Stage Flash (MSF)** process is divided into sections or stages. Saline water is heated at the boiling temperature between 90 and 110 C°, with a decreasing pressure through the stages. Part of the water flashes (quickly vaporizes) at each stage while the rest continues to flow through the following stages (Figure 2). As the MSF process can be powered by waste or by-product heat, the combined production (co-generation) of power, heat and desalinated

Table 1 – Major Desalination Technologies

Thermal Technologies	Membrane Technologies
Multi Stage Flash, MSF	Reverse Osmosis, RO
Multi Effect Distillation, MED	Electrodialysis, ED
Vapour Compression, VC	

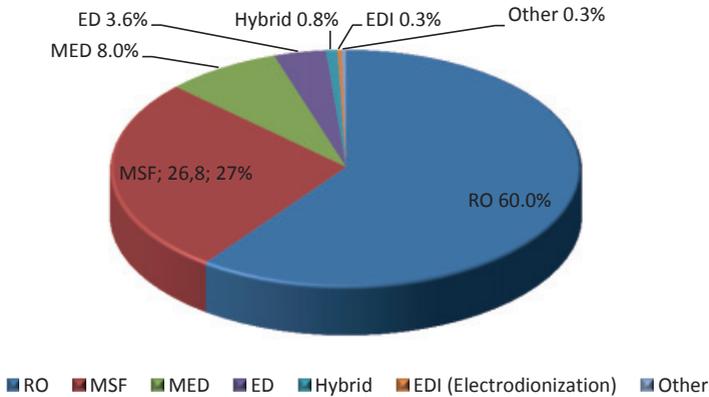


Figure 1 – Desalination Technology Market (IDA in Koschikowski, 2011)

water in the same plant is a technical solution that in MENA countries can often satisfy the demand for power and water in a cost-effective and energy-efficient manner. In the case of heat derived from a steam turbine, the turbine loses a certain amount of its electricity generation output. With an installed capacity of about 17.5 million m³/day (IDA in Koschikowski, 2011), MSF is the dominant desalination technology in the MENA region where fossil fuels are largely available at a low cost. Similar to MSF, **Multi Effect Distillation (MED)** is a multi-stage process variant in which vapor from each vessel (stage) is condensed in the following vessel and vaporized again at reduced ambient pressure. Unlike MSF, MED allows the feed-water to be processed without the need to supply additional heat for vaporization at each stage. Another technology for thermal desalination is the **Vapor Compression (VC)** distillation process, where the heat for water evaporation comes from compression rather than from direct heating. This process is generally used in combination with other processes (MED) to improve overall efficiency.

- **Membrane Desalination Technologies** – Membrane desalination uses membranes to separate fresh water from saline feed-water. Feed-water is brought to the surface of a membrane, which selectively passes water and excludes salts. In the **Reverse Osmosis (RO)**, the seawater pressure is increased above the osmotic pressure, thus allowing the desalinated water to pass through the semi-permeable membranes, leaving the solid salt particles behind (Figure 3). The RO plants are very sensitive to the feed-water quality (salinity, turbidity,

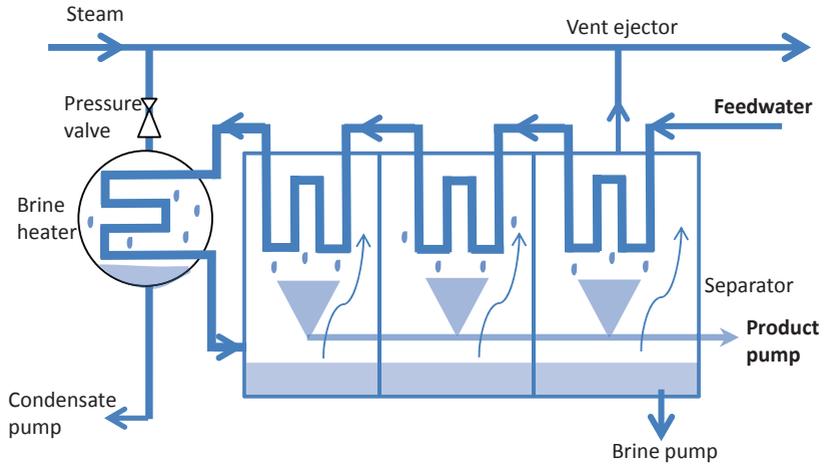


Figure 2 – MSF Desalination Process (Source: Fichtner, 2011)

temperature), while other distillation technologies are not so demanding in this respect (Goebel, 2003). High-salinity and high-temperature feed-water can limit the osmosis process as they affect the osmosis pressure, requiring more energy. High-turbidity feed-water can cause fouling where membrane pores are clogged with suspended solids.

Typical seawater salinity which is suited to RO systems is around 35,000 ppm of dissolved solids contents. However, in some regions (i.e. Red Sea, Arabian Gulf), the total dissolved solids content is higher, i.e. 41,000 ppm and 45,000 ppm, respectively (Lenntech homepage). In these regions, seawater has high fouling potential (bio-fouling due to high content of organisms), and high surface temperature (Abd El Aleem et al., 1997). Therefore, an appropriate feed-water pre-treatment is needed prior to RO desalination. RO desalination is also suited to and used for small-scale plants in rural areas or islands where there is no other water supply available. For example, most desalination plants in the Caribbean area use RO systems (CEHI, 2006). Electrodialysis (ED) is another membrane process which uses the electrical potential to move salt through the membrane, leaving freshwater behind. Currently, ED is widely used for desalinating brackish water rather than for seawater due to the fact that the energy consumption depends on salt concentration of the feed-water (EU, 2008).

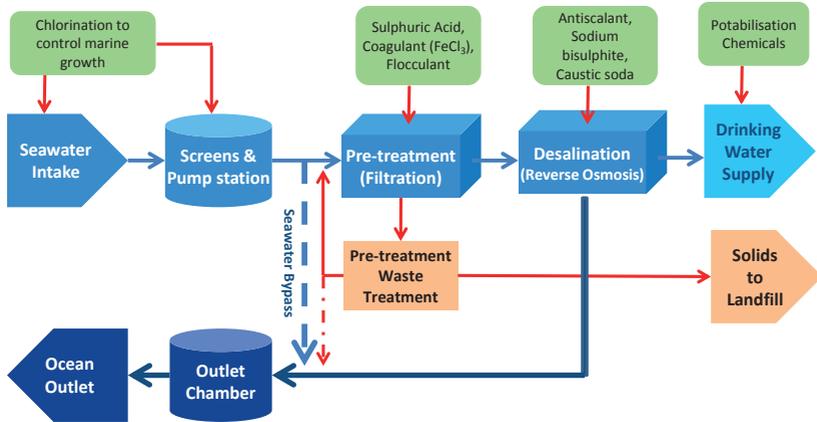


Figure 3 – RO Desalination Process (Source: Fichtner, 2011)

■ **Desalination based on Renewable Energy** – Desalination based on the use of renewable energy sources can provide a sustainable way to produce fresh water. It is expected to become economically attractive as the costs of renewable technologies continue to decline and the prices of fossil fuels continue to increase. Using locally available renewable energy resources for desalination is likely to be a cost-effective solution particularly in remote regions, with low population density and poor infrastructure for fresh water and electricity transmission and distribution. The present deployment of renewable-based desalination – i.e. less than 1% of desalination capacity based on conventional fossil fuels (EU, 2008) – does not reflect the advantages of this technology option. *Renewable desalination* is mostly based on the RO process (62%), followed by thermal processes such as MSF and MED. The dominant energy source is solar photovoltaics (PV), which is used in some 43% of the existing applications, followed by solar thermal and wind energy (EU, 2008). The right combination of a renewable energy source with a desalination technology can be the key to match both power and water demand economically, efficiently and in an environmentally friendly way. Assessing the technical feasibility and cost effectiveness of *renewable desalination* plants requires a detailed analysis, including a variety of factors, such as location, quality (salinity) of feed-water input and fresh-water output, the available renewable energy source, plant capacity and size, and the availability of grid electricity. Operation and maintenance requirements, feed-water transportation and

Table 2 – Possible combinations of renewable energy and desalination technologies (Source: Al-Karaghoul et al., 2011)

Thermal Technologies	Membrane Technologies				
	MSF	MED	VC	RO	ED
Renewable Technologies	●	●	●	●	●
Solar thermal			●	●	●
Solar PV			●	●	●
Wind	●	●	●	●	●
Geothermal	●	●	●	●	●

pre-treatment needs are also part of the decision-making process. Some technology solutions are better suited to large size plants, while others are better for small-scale applications (EU, 2008). Most common renewable options are shown in Table 2.

Renewable desalination is growing especially in arid regions with huge solar energy potentials such as the MENA region. Many of the existing *renewable desalination* systems are implemented in small capacities from a few m³ up to 100 m³/d. Only a few medium-size applications exist in the MENA region. The world's largest solar PV desalination plant using novel nano-membrane technology is under construction in the city of Al Khafji, in Saudi Arabia. It is part of the project launched by KACST (King Abdulaziz City for Science and Technology) in cooperation with IBM. It will be implemented in three stages over nine years. In the first phase, a desalination plant with a production capacity of 30,000 m³/d will meet the needs of some 100,000 people. According to *Arab News*, Saudi Arabia uses 1.5 million barrels of oil per day at its desalination plants, which provide between 50% and 70% of the country's drinking water (Oxford Business Group, 2010). Other desalination plants powered by renewable energy can be seen in Cyprus, Egypt, Jordan, Morocco, Turkey, Abu Dhabi and the Canary Islands.

- **Solar Thermal Desalination** – Seawater desalination via MSF and MED using solar heat as the energy input are promising desalination processes based on renewable energy. The desalination plant consists of two parts (i.e. solar heat collector and distiller). The process is referred to as an *indirect* process

if the heat comes from a separate solar collector or solar ponds whereas it is referred to as *direct* if all components are integrated into the desalination plant (Kalogirou, 2005). Particularly attractive is desalination associated with concentrating solar power (CSP) plants.

CSP plants (see ETSAP E10) collect solar radiation and provide high-temperature heat for electricity generation. Therefore, they can be associated with either membrane desalination units (e.g. reverse osmosis, RO) or thermal desalination units. CSP plants are often equipped with thermal storage systems to extend operation when solar radiation is not available, and/or combined with conventional power plants for hybrid operation. This paves the way to a number of design solutions which combine electricity and heat generation with water desalination via either thermal or membrane separation processes. CSP plants are also large enough to provide core energy for medium- to large-scale seawater desalination. In desert regions (e.g. MENA) with high direct solar irradiance, CSP is considered a promising multi-purpose technology for electricity, heat and district cooling production, and water desalination. An analysis by the German Aerospace Centre (DLR, 2007) for the MENA region shows that the choice between the CSP-MED process and the CSP-RO may depend on feed-water quality. The CSP-MED process is more energy efficient than the CSP-RO process in the Arabian Gulf where seawater has a high salinity level.

- **Photovoltaic Desalination** – Photovoltaic (PV) technology (ETSAP E11) can be connected directly to RO or ED desalination processes, which are based on electricity as the input energy (Figure 4). Many small PV-based desalination systems have been demonstrated throughout the world, especially in remote areas and islands, including Gran Canaria, Canary Islands (PV-RO, seawater, 1–5 m³/d), Riyadh, Saudi Arabia (PV-RO, brackish water, 5 m³/d), and Ohshima Island, Japan (PV-ED, seawater, 10 m³/d) (Kalogirou, 2005). The main issue of PV desalination is the (still) high cost of PV cells and batteries for electricity storage. Careful maintenance and operation of battery systems are also necessary. Further technology advances in electricity storage (ETSAP E18) associated to PV could lead to wider use of PV desalination.

- **Wind Power Desalination** – The electrical and mechanical power generated by a wind turbine can be used to power desalination plants, notably RO and ED desalination units, and vapor compression (VC) distillation process (in particular, Mechanical Vapor Compression, MVC). In the MVC, the mechanical energy of the wind turbine is used directly for VC without further conversion into electricity. In general, wind power based desalination can be one of the most promising options for seawater desalination, especially in coastal areas with high wind potential. Various wind-based desalination plants have been

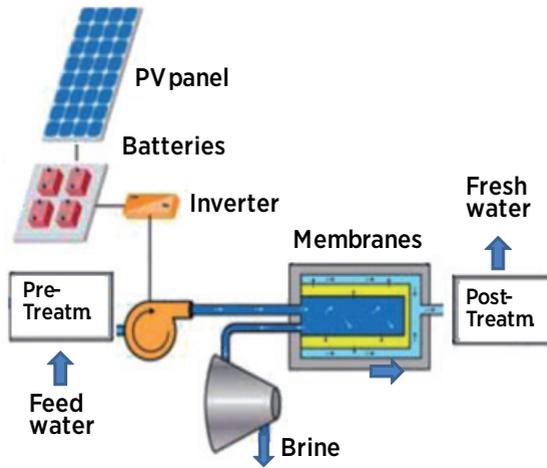


Figure 4 – Coupled PV and RO desalination plants (Al-Karaghoulí et al., 2011)

installed around the world, including Gran Canaria, Canary Islands (Wind-RO, seawater, 5–50 m³/d), Fuerteventura Island, Spain (Wind-diesel hybrid system, seawater, 56 m³/d), and the Centre for Renewable Energy Systems Technology in the United Kingdom (Wind-RO, seawater, 12 m³/d) (see Kalogirou, 2005 and Al-Karaghoulí et al., 2009). Same as for PV and CSP, a drawback of wind desalination is the intermittence of the energy source. Possible combinations with other renewable energy sources, batteries or other energy storage systems can provide smoother operating conditions. Water desalination itself can provide an excellent storage opportunity in the case of electricity generation exceeding the demand (Gude et al., 2010).

- **Geothermal Desalination** – As geothermal energy can produce electricity and heat, it can be combined with both thermal and membrane desalination technologies. Low-temperature geothermal energy, typically in the range of 70–90°C, is ideal for MED desalination. A project on Milos Island, Greece, has proposed a geothermal desalination system to produce 1,920 m³/d of water. The plant consists of a dual system with hot water from geothermal wells being employed to run either an organic Rankine cycle (ORC) with a 470-kWe turbine for electricity generation or a MED desalination unit. The system can benefit the local community by producing desalinated water at a very low

cost, i.e. USD 2/m³ (Constantine, 2004). However, the exploitation of geothermal energy very much depends on the specific local conditions, with upfront investment costs that are usually high.

- **Energy Implications of Desalination** – Desalination requires a considerable amount of energy. Membrane desalination (RO) requires only electricity while thermal desalination (MSF, MED) requires both electricity and thermal energy, and – in total – more energy than the membrane process. Seawater desalination via MSF consumes typically 290 kJ/kg of thermal energy plus 2.5–3.5 kWh/m³ of electricity, while large-scale RO desalination requires around 3.5–5.0 kWh/m³ of electricity (EU, 2008). Table 3 shows key, typical energy data for different desalination technologies. Taking into account the average energy demand of desalination processes (i.e. 5 kWh/m³ for MSF, 2.75 kWh/m³ for MED, 2.5 kWh/m³ for RO, and 2.75 kWh/m³ for ED), the global desalination capacity (i.e. 65.2 million m³/day) requires the use of approximately 206 million kWh per day, equivalent to 75.2 TWh per year. Renewable energy, notably CSP with thermal storage systems, can significantly contribute to reduce the fossil fuels (and associated CO₂ emissions) used for desalination. Other variable renewable energy sources, such as solar PV and wind power can also offer significant contributions if associated with energy storage systems. Desalination itself can be seen as a viable option to store renewable electricity, which exceeds the demand.

Table 3 – Key, typical energy data for desalination technologies
(Main source: EU, 2008)

	MSF	MED	SWRO ¹	ED
Operation temp., °C	90–110	70	Ambient	Ambient
Electricity demand, kWh/m ³	2.5–3.5	1.5–2.5	3.5–5.0	1.5–4.0 feed water with 1500–3500 ppm solids
Thermal energy demand, kWh/ m ³	80.6 (290 kJ/kg)	80.6 (290 kJ/kg)	0	0

SWRO: Spiral wound reverse osmosis

Desalination Costs

The cost of desalination is largely dominated by the energy cost. Therefore, the economic feasibility of desalination depends strongly on local availability and cost of energy (Zeji et al., 2002). Comparisons between different desalination technologies should be based on identical local conditions. Site-specific aspects, which also have a significant impact on final costs, include feed-water transportation, fresh water delivery to end-users, brine disposal and the size of the plant. As far as capital (investment) and operation and maintenance cost is concerned, a comparison of two most used conventional desalination systems, i.e. RO and MSF, to be installed in Libya (Al-Karaghoul, 2011) shows that the MSF plant requires higher capital costs while the RO plant requires higher operation and maintenance costs due to the plant complexity. Typical figures for the investment cost of new installed desalination capacity range between USD 800 and USD 1500 per unit of capacity (m^3/d), with large variations depending on local conditions (labour cost, interest rate, etc.). Typical operation and maintenance costs are estimated at about 2-2.5% of the investment cost per year. As for the overall desalination cost, significant reductions have occurred over the past years, but water desalination remains economically affordable only for middle-income countries and too expensive for poor countries. The typical production cost of conventional desalination plants running on fossil fuels is between USD1/ m^3 and USD 2/ m^3 . Under most favorable conditions (i.e. modern large-scale plants), the production cost can be as low as USD 0.5/ m^3 (Moilanen et al., 2010). Also, a typical conventional desalination plant requires 30% of the total cost for energy with an electricity price of 5-6 US cents/kWh.

In general, desalination based on renewable energy sources is still expensive if compared with conventional desalination, as both investment and generation costs of renewable energy are higher. However, under certain circumstances – e.g. installations in remote areas where distributed energy generation (heat and power) is more convenient than centralized energy generation, transmission and distribution – *renewable desalination* could compete with conventional systems.

Costs of desalinated fresh water from most common desalination processes based on renewable energy are shown in Table 4 (Papapetrou et al., 2010 and European Union 2008). Most of such technologies have already been demonstrated, except for Solar/CSP-MED. With the rapid decrease of renewable energy costs, technical advances and increasing number of installations, *renewable desalination* is likely to reduce significantly its cost in the near future and become an important source of water supply for regions affected by water scarcity.

Table 4 – Comparative costs for common renewable desalination
(Source: Papapetrou et al., 2010 and European Union, 2008)

	Technical Capacity	Energy Demand (kWh/m ³)	Water Cost (USD/m ³)	Development Stage
Solar stills	< 0.1m ³ /d	Solar passive	1.3–6.5	Application
Solar-Multiple Effect Humidification	1–100 m ³ /d	thermal: 100 electrical: 1.5	2.6–6.5	R&D Application
Solar- Membrane Distillation	0.15–10 m ³ /d	thermal: 150–200	10.4–19.5	R&D
Solar/CSP-Multiple Effect Distillation	> 5,000 m ³ /d	thermal: 60–70 electrical: 1.5–2	2.3–2.9 (possible cost)	R&D
Photovoltaic-Reverse Osmosis	< 100 m ³ /d	electrical: BW: 0.5–1.5 SW: 4-5	BW: 6.5–9.1 SW: 11.7–15.6	R&D Application
Photovoltaic-Electrodialysis Reversed	< 100 m ³ /d	electrical: only BW:3–4	BW:10.4–11.7	R&D
Wind- Reverse Osmosis	50–2,000 m ³ /d	electrical: BW: 0.5–1.5 SW: 4–5	Units under 100 m ³ /d, BW:3.9–6.5 SW:6.5–9.1 About 1,000 m ³ /d, 2–5.2	R&D Application
Wind- Mechanical Vapor Compression	< 100 m ³ /d	electrical: only SW:11–14	5.2–7.8	Basic Research
Wind-Electrodialysis	–	–	BW: 2.0–3.5	–
Geothermal-Multi Effect Distillation	–	–	SW: 3.8–5.7	–

Solar Stills: simple and old technology where the incident short wave radiation is transmitted and absorbed as heat

Multiple Effect Humidification: use of heat from highly efficient solar thermal collectors to induce multiple evaporation/condensation cycles

Membrane Distillation: thermally driven distillation process with membrane separation

Reversed Electrodialysis: same principle as **Electrodialysis** (ED) except for the fact that the polarity is reversed several times per hour

CSP: Concentrated Solar Power

BW: Brackish Water; **SW:** Sea Water

Note: cost calculated at the exchange rate of 1.3 from euro to USD.

Potential, Sustainability and Barriers

■ **Potential** – The global capacity of desalination plants, including *renewable desalination*, is expected to grow at an annual rate of more than 9% between 2010 and 2016, with a cumulative investment of about USD 88 billion. As seen in Figure 5, the market is set to grow in both developed and emerging countries such as the United States, China, Saudi Arabia (SA) and the United Arab Emirates (UAE). A very significant potential also exists in rural and remote areas, as well as islands (Figure 5, rest of world, ROW) where grid electricity or fossil fuels to generate energy may not be available at affordable costs. About 54% of the global growth is expected to occur in the MENA region (Pike Research, 2010). The International Energy Agency projects that in the MENA region, because of the growing population and depletion of surface and groundwater resources, the total water demand will increase from 9 billion m³ in 2010 up to 13.3 billion m³ in 2030 (IEA, 2005). As a consequence, the desalination capacity in the MENA region is expected to grow from 21 million m³/d in 2007 to nearly 110 million m³/d by 2030 (of which 70% is in Saudi Arabia, the United Arab Emirates, Kuwait, Algeria and Libya). This will

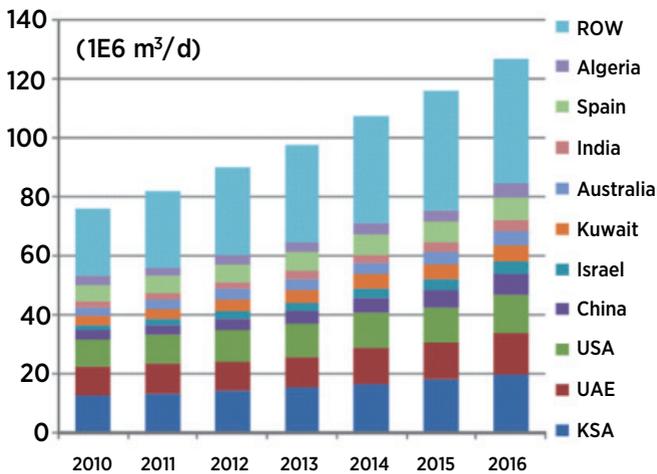


Figure 5 – Global installed desalination capacity, 2010–2016, (Pike Research, 2010)

contribute to the surge in energy use in the region. The annual electricity demand for desalination in the MENA region is expected to rise to 122 TWh by 2030, a factor of three higher compared with 2007 (IEA, 2009). As already mentioned, solar energy, in particular CSP with thermal energy storage, shows a significant potential for combined production of electricity and fresh water in the MENA region. In the water demand scenario elaborated by DLR (Figure 6), the CSP-based desalination is projected to become a major process for water production in MENA, accounting for about 16% of total water production in 2030 and 22% in 2050. This scenario involves the availability of surface- and ground-water according to mild-to-average climate change and desertification scenarios. On the other hand, matching the appropriate types of desalination technologies requires careful assessments. Membrane technologies are not well suited to seawater desalination in regions where seawater salinity is higher because they require energy-intensive pretreatment to avoid fouling.

Desalination will also be crucial in countries such as Egypt, which face serious water deficits due to population and economic growth. In Egypt, the growing water demand can no longer be met by the Nile water supply (Yousef et al., 2007). In 2025, Egyptian water demand is expected to reach a level of 130 billion m³/year, with more than 80% used for agriculture, while water supply is currently expected to remain at 73 billion m³/yr, leaving a huge deficit (Yousef et al., 2007).

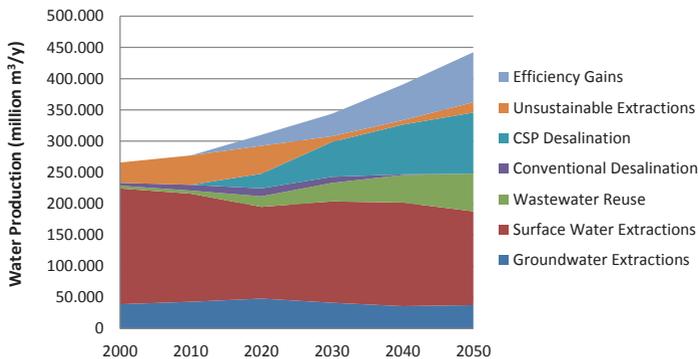


Figure 6 – Water demand scenario in MENA, 2000–2050
(Source: Trieb et al, 2011)

China and India are also high potential markets for desalination due to population and economic growth along with water shortages. In China, the central government pays a lot of attention to desalination and cities on the east coast are implementing desalination plants to alleviate water scarcity (Haijun et al., 2008).

Many Pacific islands also face water scarcity which poses food, economic, and health security issues. These countries are keen to accelerate renewable energy deployment to diversify their energy mix and reduce dependency on fossil fuels. Therefore, implementation of small stand-alone *renewable desalination* systems can provide viable solutions to both water and energy issues in the region.

Australia has recently pursued desalination technologies to meet its growing water demand. Most desalination plants are in Western Australia (WA) where the Government of Western Australia requires new desalination plants to use renewable energy. The landmark project was the Perth Seawater Desalination Plant (SWRO), which buys electricity generated by a wind farm north of Perth. The plant is designed to optimize the energy consumption and requires 3.4 kWh/m³, including overhead, and 2.2kwh/m³ for the plant only.

- **Barriers** – Combining variable renewable technologies and desalination processes, which require a constant energy supply, involves technical, economic and organizational issues. Technical developments include a large availability of low-cost renewable energy and energy storage technologies to face the variable nature of renewable energy. A key issue is the disposal of brine. High salt-content brine is the desalination waste to be disposed of or recycled. At present, it is mostly discharged into the sea or diluted and sprayed into an open space. However, the negative impact of brine on the ecosystems and the growing desalination capacity mean that a sustainable solution is needed for disposal and/or brine recycling to avoid environmental impacts (Gude, 2010). From an economic point of view, the identification of niche markets and proper policy frameworks may help attract private investors for *renewable desalination* to take off (Papapetrou, 2010). Not least, more cooperation and integration is needed between companies from the energy sector and companies from the water sector (Papapetrou, 2010), and more attention needs to be paid to barriers for developing countries, including high investment and operation costs, and trained personnel to run the plants.

References and Further Information

1. Abd El Aleem, F.A., et al., 1997, Biofouling problems in membrane processes for water desalination and reuse in Saudi Arabia, *International Biodeterioration & Biodegradation* 41 (1998) 19–23.
2. Al-Karaghoul, A.A. et al., 2011, *Renewable Energy Opportunities in Water Desalination, Desalination, Trends and Technologies*, Michael Schorr (Ed.), ISBN: 978-953-307-311-8, InTech. http://cdn.intechopen.com/pdfs/13758/InTech-Renewable_energy_opportunities_in_water_desalination.pdf.
3. Al-Karaghoul, A.A. et al., 2009, Solar and wind for water desalination in the Arab regions, *Renewable and Sustainable Energy Reviews* 13 (2009) 2397–2407. <http://www.intechopen.com/articles/show/title/renewable-energy-opportunities-in-water-desalination>.
4. Black and Veatch, 2011, Q2, Addressing water scarcity, *SOLUTIONS* volume 32, Black and Veatch, USA. http://www.bv.com/Downloads/Resources/Solutions/Solutions_2011Q2.pdf.
5. Caribbean Environmental Health Institute (CEHI), 2006, *The Evaluation of the Use of Desalination Plants in the Caribbean*, United Nations Educational, Scientific and Cultural Organization (UNESCO).
6. European Union, 2008, ADIRA Handbook, A guide to desalination system concepts, Euro-Mediterranean Regional Programme for Water Management (MEDA), ISBN 978-975-561-311-6. http://wri.nmsu.edu/conf/conf11/2008_adira_handbook.pdf.
7. Fichtner, 2011, MENA Regional Water Outlook Part II Desalination Using Renewable Energy. Fichtner, Germany. http://www.medrc.org/download/twb/FICHT-6911691-v3-Task_1-Desalination_Potential.pdf.
8. German Aerospace Centre (DLR), 2007, AQUA-CSP, Concentrating Solar Power for Seawater Desalination, DLR Institute of Technical Thermodynamics Section System Analysis and Technology Assessment, Germany.
9. Goebel, O., 2003, Co-Generation of Power and Water- Selection of Desalination Process, Lahmeyer International GmbH, Germany.
10. Gude, V. et al., 2010, Renewable approaches for desalination, *Renewable & Sustainable Energy Reviews* 14 (2010) 2641–2654.
11. Hajjun J. et al., Nuclear Seawater Desalination Plant Coupled with 200 MW Heating Reactor, International Symposium on the Peaceful Applications of Nuclear Technology, Jeddah, Saudi Arabia.
12. IEA, 2005, *World Energy Outlook 2005, Middle East and North Africa Insights*. International Energy Agency (IEA).
13. IEA, 2009, *World Energy Outlook 2009*, International Energy Agency (IEA).
14. IEA, 2010, *World Energy Outlook 2010*, International Energy Agency (IEA).

15. Kalogirou, S.A., 2005, Seawater desalination using renewable energy sources, *Energy & Combustion Science* 31 (2005) 242–281.
16. Karytsasa, C. et al., 2004, Development of the geothermal field of Milos Island in Greece, *Geo-Heat Center (GHC) Bulletin*, USA.
17. Koschikowski, J., 2011, Water Desalination: When and Where Will it Make Sense?, presentation at the 2011 Annual meeting of the American Association for the Advancement of Science, Fraunhofer Institute for Solar Energy Systems (ISE). http://ec.europa.eu/dgs/jrc/downloads/jrc_aaas2011_energy_water_koschikowski.pdf.
18. Lenntech, Water Treatment Solutions. <http://www.lenntech.com/composition-seawater.htm>.
19. Moilanen, P. et al., 2010, Mobilizing funds in water sector: private sector potential for desalination in the Levant region. FIIA, Finland.
20. Oxford Business Group, 2010, *The Report: Saudi Arabia*. Oxford Business Group, Oxford.
21. Papapetrou, M. et al., 2010, Roadmap for the development of desalination powered by renewable energy, Promotion of renewable energy for water desalination. http://wrii.nmsu.edu/conf/conf11/prodes_roadmap_online.pdf.
22. Pike Research, 2010, Research Report, Executive summary: Desalination Technology Markets – Global Demand Drivers, Technology Issues, Competitive Landscape, and Market Forecasts. Pike Research, USA.
23. Rosegrant, M.W. et al., 2002, Global Water Outlook to 2025, Averting an Impending Crisis, International Food Policy Research Institute and International Water Management Institute. <http://www.ifpri.org/sites/default/files/pubs/pubs/fpr/fpr-water2025.pdf>.
24. Trieb, F. et al., 2011, MENA Regional Water Outlook Desalination Using Renewable Energy, Overview of DLR work within the MENA Regional Water Outlook study. Muscat. http://elib.dlr.de/72591/1/Workshop_Oman_Final_DLR.pdf.
25. UNEP, 1997, Source Book of Alternative Technologies for Freshwater Augmentation in Latin America and the Caribbean, International Environmental Technology Centre, United Nations Environment Programme, Washington, D.C.
26. UN OCHA, 2010, Water Scarcity and Humanitarian Action: Key Emerging Trends and Challenges, UN. <http://ochanet.unocha.org/p/Documents/OCHA%20OPB%20Water%20%2011Nov10%20fnl.pdf>.
27. Yousef, R.M., et al., 2007, *Desalination Technology Roadmap 2030, Information and Decision Support-* Center for Future Studies.
28. Zeji, D., et al. 2002, Applications of solar and wind energy sources to sea-water desalination- economical aspects, International conference on nuclear desalination: challenges and options, Marrakech, Morocco.

Summary key data for conventional desalination

Table 5 – Summary Table – Key Data and Figures for Conventional Water Desalination

Conventional Water Desalination					
Energy input	Fossil Energy (heat and/or electricity)				
Output	Fresh water				
Technology Variants	Thermal Processes			Membrane Separation Processes	
	MSF	MED	VC (MVC)	RO	ED
Energy input	Heat & electrical	Heat & electrical	Heat & electrical (mechanical power)	Electrical	Electrical
Feed water	More than 60% seawater (SW) plus brackish water (BW); Some high-salinity seawater may need pre-treatments for membrane separation				
Energy use	80.6 kWh/m ³ (290 kJ/kg equivalent) plus 2.5–3.5 kWh/m ³	80.6 kWh/m ³ (290 kJ/kg equivalent) plus 1.5–2.5 kWh/m ³	na	0 kJt /kg 3.5–5.0 kWh/m ³	0 kJt /kg 1.5–4.0 kWh/m ³
Typical total energy use	5 kWh/m ³	2.75 kWh/m ³	na	2.5 kWh/m ³	2.75 kWh/m ³
Operation temperature, °C	90-110	70	na	room temp.	room temp.
Plant lifetime, yr	na	na	na	na	na
Capacity factor, %	na	na	na	na	na
Market share, %	27	8	na	60	4
Global capacity (2011), m ³ /day	72 million m ³ /day (about 65 million m ³ /day in operation) over about 15,000 plants				
Average plant capacity, m ³ /day	4,000–5,000				
Largest plant capacity, m ³ /day	800,000				
Major producers	MENA (Saudi Arabia), United States, China. About 38% of the global capacity (2,800 plants) in MENA				
Emissions	Emissions are associated with the primary energy used to power desalination plants				
Waste	Brine (high-salinity waste water)				

Desalination Costs	Typical current international values for new installed capacity (2010 USD)
Capital cost per unit of capacity	\$800 - \$1,500/m ³ /day. Large variations depending on local labor cost, interest rates and technology
O&M cost per year	1.5-2.5 % of the investment cost per year
Fresh water production cost	USD 1-2/m ³ (USD 0.5/m ³ for large size plants), largely depending on energy cost and plant location
Projected Market Growth	
global desalination capacity	+ 9% per year between 2010 and 2016 (54% in MENA, reaching 110 million m ³ /d by 2030)
Investment	USD 88 billion between 2010 and 2016
Major producers/users	Saudi Arabia, UAE, US, China, rural remote areas and islands in the rest of world

Summary key data for desalination using renewable energy

Technology Variants	Renewable Water Desalination							
	Solar stills	Solar MED	Solar Membrane Distillation	Solar CSP/MED	PV/RO	PV/ED	Wind/RO	Wind/MVC
Development status	Applic.	Applic./R&D	R&D	R&D	Applic./R&D	R&D	Applic./R&D	Basic R&D
Energy input, kWh/m ³ +kJt/kg	Solar passive	1.5+100	0 +<200	1.5-2.0 + 60-70	0.5-1.5 BW 4.0-5.0 SW + 0	3.0-4.0 BW + 0	0.5-1.5 BW 4.0-5.0 SW + 0	11-14 SW + 0
Typical current capacity, m ³ /day	0,1	1-100	0.1-10	>5,000	<100	<100	50-2,000	<100
Market share of renewable desalination	<1% of the global desalination capacity (62% based on RO, 43% powered by PV)							
Production cost, USD/m³	1.3-6.5	2.6-6.5	10.4-19.5	2.3-2.9	6.5-91 BW 11.7-15.6 SW	10.4-11.7	3.9-6.5 BW 6.5-9.1SW	5.2-7.8

Disclaimer

The designations employed and the presentation of materials herein do not imply the expression of any opinion whatsoever on the part of the Secretariat of the International Renewable Energy Agency concerning the legal status of any country, territory, city or area or of its authorities, or concerning the delimitation of its frontiers or boundaries. The term “country” as used in this material also refers, as appropriate, to territories or areas.

Please send comments to

Mirei Isaka (misaka@irena.org), Author, and to

Giorgio Simbolotti (Giorgio.Simbolotti@enea.it), Giancarlo Tosato (gct@etsap.org) and
Dolf Gielen (dgielen@irena.org), Project Coordinators